


**JOINT AND FINISH DETAIL**  
NTS

EXPANSION JOINT IN BOTH CURB AND SIDEWALK

PREMOLDED JOINT FILLER

(A) CONTRACTION JOINT

(B) EXPANSION JOINT

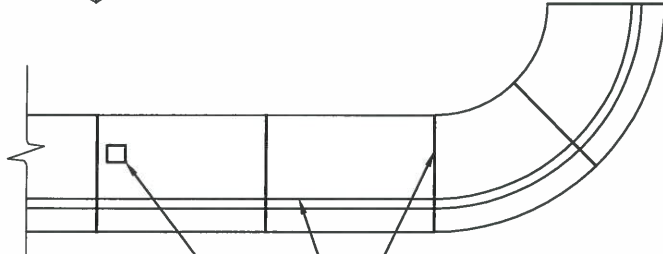

**TYPICAL CURB RETURN**  
NTS

3/8" EXPANSION JOINTS AROUND ALL STRUCTURES IN SIDEWALK. (POLES, BOXES, ETC.)

3/8" THICK, FULL DEPTH ASPHALT EXPANSION JOINT FILLER AT POINTS OF TANGENCY AND AT INTERVALS OF 20'-0" & BACK OF CURB. 1.5" DEEP CONTRACTION JOINTS EVERY 5' BETWEEN FULL DEPTH EXPANSION JOINTS. FORMS SHALL BE USED AT EACH EXPANSION JOINT LOCATION AND EXTEND THE FULL DEPTH OF THE CONCRETE

**NOTE:**

1) FOUR FEET OF THE SIDEWALK WIDTH SHALL BE THE MINIMUM PEDESTRIAN ACCESSIBLE ROUTE FREE OF VERTICAL AND HORIZONTAL OBSTRUCTIONS. GRATINGS, ACCESS COVERS, JUNCTION BOXES, CABLE VAULTS, PULL BOXES AND OTHER APPURTENANCES WITHIN THE SIDEWALK MUST HAVE SLIP RESISTANT SURFACES, BE FLUSH WITH SURFACE, AND MATCH GRADE OF THE SIDEWALK.

**CEMENT CONCRETE SIDEWALK LAYOUT DETAILS**



APPROVED BY: [Signature]  
County Engineer: \_\_\_\_\_ DATE: 5/14/15

REVISION:	DESCRIPTION:	DATE:

**STANDARD PLAN**  
**S-3**  
**SHEET 1 OF 1**

Q:\Standards\STREET\S3.dwg - 5/8/2015 1:15:30 PM