


* SEE TYPICAL ROADWAY SECTION FOR DIMENSIONS

SECTION B
0.33' THICK SIDEWALK SECTION
NTS

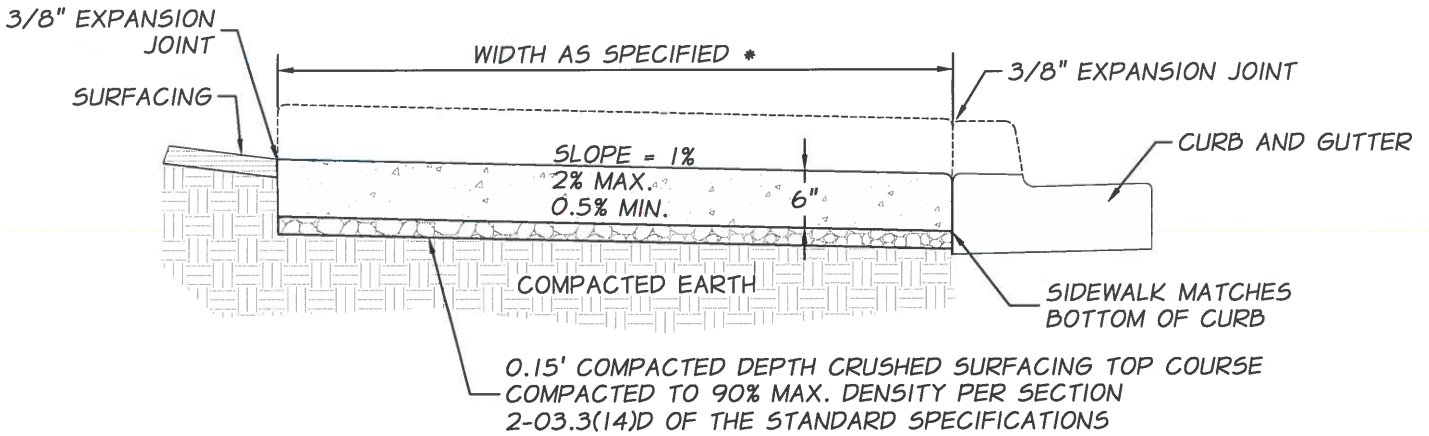

* SEE TYPICAL ROADWAY SECTION FOR DIMENSIONS

SECTION C
0.5' THICK SIDEWALK SECTION AT DRIVEWAYS
NTS

NOTES:

- 1) ANY SIDEWALK PANEL WITH A CROSS SLOPE GREATER THAN 2% SHALL BE REMOVED AND REPLACED.
- 2) FOR MOUNTABLE CURB AND GUTTER, CURB SIDEWALK SHALL BE A MINIMUM OF 0.5' THICK.

CEMENT CONCRETE SIDEWALK SECTIONS



APPROVED BY: [Signature]
County Engineer: _____ DATE: 5/14/15

REVISION:	DESCRIPTION:	DATE:

STANDARD PLAN
S-7
SHEET 2 OF 2